


COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, CLASS H, 60 AMPERE, 600 V AC, ONE, TWO, AND THREE POLE

The General Services Administration has authorized the use of this commercial item description for all federal agencies.

1. **SCOPE.** This commercial item descriptions (CID) covers the general requirements for one, two, and three pole, 600 V AC, type H fuseholder blocks. Fuseholders covered by this CID are intended for commercial/industrial applications.
2. **CLASSIFICATION/PART OR IDENTIFICATION NUMBER (PIN).** This CID uses a classification system which is included in the PIN as shown in the following example (see 7.1).

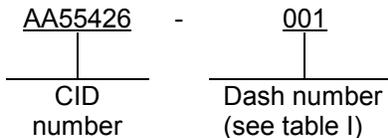

3. SALIENT CHARACTERISTICS.

- 3.1 **Interface and physical dimensions.** Fuseholders supplied to this CID shall be as specified herein and shall meet the requirements of [UL 4248-1](#) and [UL 4248-6](#) for class H fuseholders (see [figure 1](#)).
- 3.2 **Ampere rating.** The ampere rating shall be 60 amperes maximum.
- 3.3 **Voltage rating.** The voltage rating shall be 600 V ac maximum.
- 3.4 **Interrupting rating.** This class H fuseholder shall be used with class H fuses that have an interrupting rating of 10,000 amperes maximum.
- 3.5 **Wire termination.** Wire termination shall be specified on [figure 2](#) and as follows:
 - a. Screw connector for use with spade tugs or ring terminals.
 - b. Screw with pressure plate connector for use with solid or standard wire without terminal (recommended where vibration will be a factor).
 - c. Box lug connector (the most durable). For use with all types of wire without terminal.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data that may improve this document should be sent to: DLA Land and Maritime, ATTN: VAT, P.O. Box 3990, Columbus, OH 43218-3990, or email <mailto:CircuitProtect@dla.mil>. Since contact information can change you may want to verify the currency of the address information using the ASSIST Online database at <https://assist.dla.mil>.

A-A-55426D

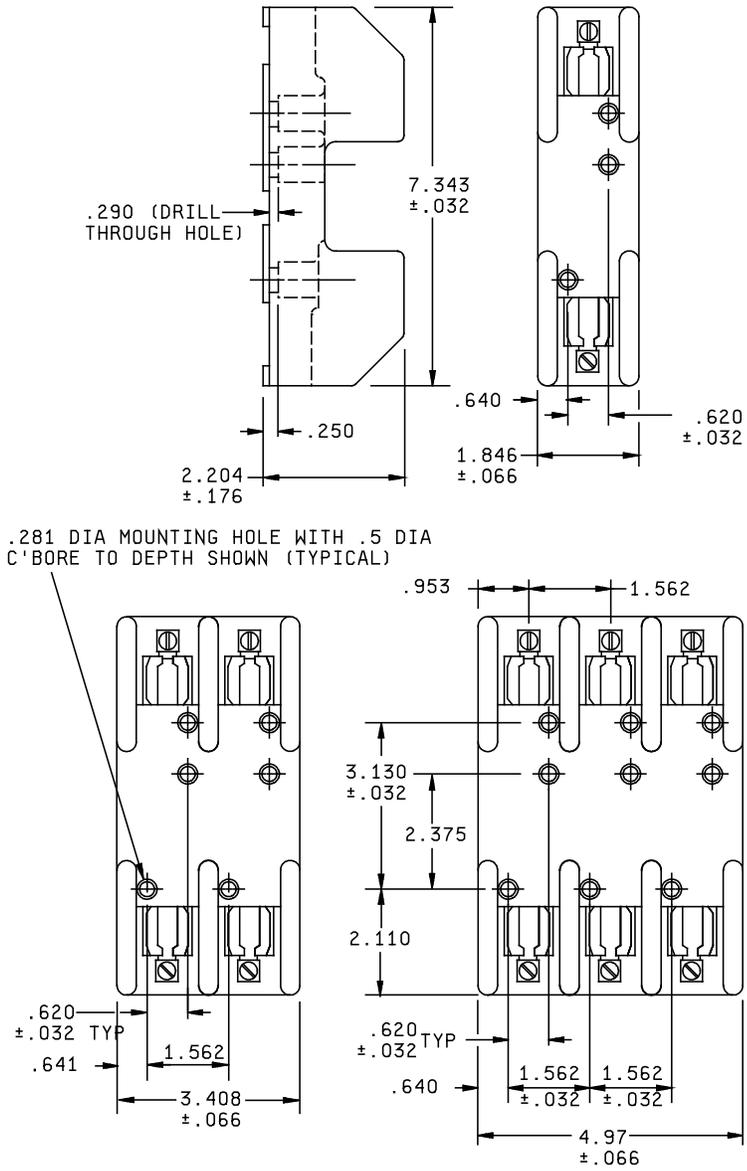


FIGURE 1. Configuration and dimensions.

Inches	mm	Inches	mm
.250	6.35	1.906	48.41
.281	7.14	2.109	53.57
.50	12.7	2.375	60.32
.625	15.87	3.125	79.37
.640	16.27	3.468	88.10
.953	24.20	5.031	127.9
1.562	39.68	7.343	186.53

NOTES:

1. Dimensions are in inches.
2. Tolerance is ± 0.005 inch (0.13 mm), unless otherwise specified.

FIGURE 1. Configuration and dimensions - Continued.

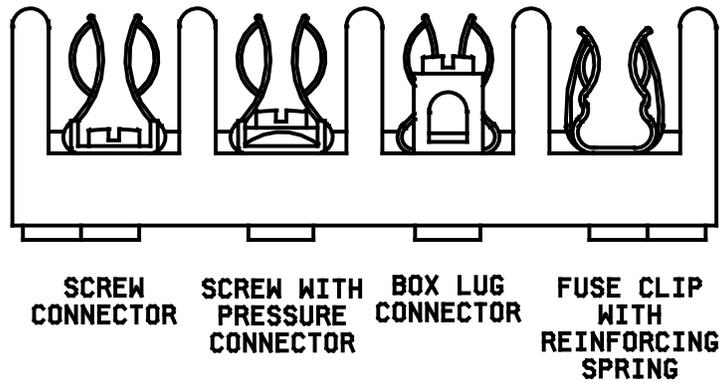


FIGURE 2. Wire termination configuration.

TABLE I. Characteristics.

AA55426-	Characteristics
001	1 pole with screw connectors.
002	1 pole with screw connectors. Fuse clips with reinforcing springs.
003	1 pole with screws with pressure plate connectors.
004	1 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs.
005	1 pole with box lug connectors.
006	1 pole with box lug connectors. Fuse clips with reinforcing springs.
007	2 pole with screw connectors.
008	2 pole with screw connectors. Fuse clips with reinforcing springs.
009	2 pole, screws with pressure plate connectors.
010	2 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs.
011	2 pole, screws with pressure plate connectors.
012	2 pole with box lug connectors. Fuse clip with reinforcing springs.
013	3 pole with screw connectors.
014	3 pole with screw connectors. Fuse clips with reinforcing springs.
015	3 pole, screws with pressure plate connectors.
016	3 pole, screw with pressure plate connectors. Fuse clips with reinforcing springs.
017	3 pole with box lug connectors.
018	3 pole with box lug connectors. Fuse clips with reinforcing springs.

3.6 Wire size. The maximum wire size shall be #2 CU-AL for screw connectors and screw with pressure plate connectors and #2 CU-AL for box lug connectors.

3.7 Reinforcing spring. Reinforcing springs are used for reinforcement of the fuse clip. Spring reinforced fuse clips are recommended if frequent fuse replacement is expected.

3.8 Fuse accomodation. This fuseholder accepts class H fuses with dimensions of 1.062 inch x 5.50 inches (26.98 mm x 138.7 mm).

3.9 Marking. Fuseholders supplied to this CID shall be marked with the manufacturer's (MFR's) standard commercial PIN and the UL listing mark. (NOTE: The part number marked on the unit pack shall be the CID PIN.)

3.10 Recycled, recovered, or environmentally preferable materials. Recycled, recovered, or environmentally preferable materials should be used to the maximum extent possible provided that the material meets or exceeds the operational and maintenance requirements, and promotes economically advantageous life cycle costs.

3.11 Workmanship. Fuseholders shall be processed in such a manner as to be uniform in quality and shall be free from other defects that will affect life, serviceability, or appearance.

4. **REGULATORY REQUIREMENTS.** The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the [Federal Acquisition Regulation \(FAR\)](#).

5. PRODUCT CONFORMANCE PROVISIONS

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

- a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.
- b. The company producing the item must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Environmentally preferable materials. Environmentally preferable materials should be used to the maximum extent possible to meet the requirements of this specification. As of the dating of this document, the U.S. Environmental Protection Agency (EPA) is focusing efforts on reducing 31 priority chemicals. The list of chemicals and additional information is available on their website <http://www.epa.gov/wastes/hazard/wastemin/priority.htm>. Included in the EPA list of 31 priority chemicals are cadmium, lead, and mercury. Use of these materials should be minimized or eliminated unless needed to meet the requirements specified herein (see section 3).

7.3 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuseholders to DLA Land and Maritime under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.4 Source of documents.

Federal Regulations

FEDERAL ACQUISITION REGULATION (FAR)

[FAR - Federal Acquisition Regulations](#).

(Copies of this document is available online at <http://www.acquisition.gov/comp/far/index.html> or from the U.S. Government Printing Office, 732 N. Capital Street, NW, Washington D.C. 20401-0001.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

[UL 4248-1](#) - UL Standard for Safety Fuseholders - Part 1: General Requirements.

[UL 4248-6](#) - UL Standard for Safety Fuseholders- Part 6: Class H.

(Copies of these documents are available online at <http://www.ul.com/> or from the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.5 Ordering data. The contract or order should specify the following:

- a. CID document number, revision, and CID PIN.
- b. Product conformance provisions.
- c. Packaging requirements.

7.6 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

<u>MFR's CAGE</u>	<u>MFR's name and address</u>
26405	Marathon Special Products 13300 Van Camp Road P.O. Box 468 Bowling Green, OH 43402-0468 Phone number (419) 352-8441 Facsimile number (419) 352-0875 E-mail: mailto:marketing@marathonsp.com Uniform Resource Locator (URL): http://www.marathonsp.com/
71400	Cooper Bussmann, Incorporated P. O. Box 14460 St. Louis, MO 63178-4460 Phone number (636) 394-2877 Facsimile number (800) 544-2570 E-mail: mailto:fusebox@cooperindustries.com URL: http://www.cooperindustries.com
71424	Mersen 374 Merrimac Street Newburyport, MA 01950-1930 Phone number (978) 462-6662 Facsimile number (978) 462-0181 E-mail: mailto:technicalservices.nby@mersen.com URL: http://ep-us.mersen.com

75915 Littelfuse Incorporated
 8755 W. Higgins Road; Suite 500
 Chicago, IL 60631-2708
 Phone number (800) 999-9445
 Facsimile number (847) 391-0753
 E-mail: <mailto:electronics@littelfuse.com>
 URL: <http://www.littelfuse.com>

7.7 Part number (P/N) supersession data. This CID supersedes the following MFR's P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE III. P/N supersession data.

CID dash number AA55426-	MFR's CAGE 26405	MFR's CAGE 71400	MFR's CAGE 71424	MFR's CAGE 75915
	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>
001	N/A	N/A	60611	N/A
002	N/A	N/A	60616	N/A
003	N/A	N/A	N/A	N/A
004	N/A	N/A	N/A	N/A
005	6F60A1B	H60060-1C	60601	LH60060-1C
006	R6F60A1B	H60060-1CR	60606	LH60060-1CR
007	N/A	N/A	60612	N/A
008	N/A	N/A	60617	N/A
009	N/A	N/A	N/A	N/A
010	N/A	N/A	N/A	N/A
011	6F60A2B	H60060-2C	60602	LH60060-2C
012	R6F60A2B	H60060-2CR	60607	LH60060-2CR
013	N/A	N/A	60613	N/A
014	N/A	N/A	60618	N/A
015	N/A	N/A	N/A	N/A
016	N/A	N/A	N/A	N/A
017	6F60A3B	H60060-3C	60603	LH60060-3C
018	R6F60A3B	H60060-3CR	60608	LH60060-3CR

1/ The manufacturer's P/N shall not be used for acquisition to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown. For actual part marking requirements see 3.9.

7.8 Government users. To acquire information on obtaining these fuseholder blocks from the Government inventory system, contact DLA Land and Maritime, ATTN: DLA Land and Maritime-FMX, Post Office Box 3990, Columbus, OH 43218-3990, or telephone (614) 692-3677.

7.8.1 National stock number (NSN). The following is a list of NSN's assigned which correspond to this CID. The list is for information only and may not be indicative of all possible NSN's associated with the CID. For up to date information on assigned NSN's, please contact the aforementioned DLA Land and Maritime office (See 7.8).

TABLE IV. NSN's.

Dash number (see table I) AA55426-	NSN	Dash number (see table I) AA55426-	NSN
001	N/A	010	N/A
002	N/A	011	N/A
003	N/A	012	N/A
004	N/A	013	N/A
005	N/A	014	N/A
006	N/A	015	N/A
007	N/A	016	N/A
008	N/A	017	5920-01-188-6293
009	N/A	018	5920-01-257-4284

7.9 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

MILITARY INTERESTS:

Custodians:
Navy - EC
DLA - CC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FAS

Preparing activity:

DLA-CC

Project 5920-2012-034

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at <https://assist.dla.mil>.