


COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, CLASS H, 30 AMPERE, 600 V AC, ONE, TWO, AND THREE POLE

The General Services Administration has authorized the use of this commercial item description for all federal agencies.

1. **SCOPE.** This commercial item description (CID) covers the general requirements for one, two, and three pole, 30 ampere, 600 V AC, type H fuseholder blocks. Fuseholders covered by this CID are intended for commercial/industrial applications.
2. **CLASSIFICATION/PART OR IDENTIFICATION NUMBER (PIN).** This CID uses a classification system which is included in the PIN as shown in the following example (see 7.1).

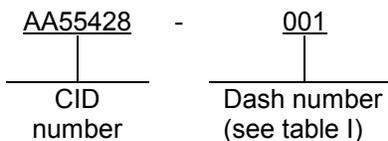

3. SALIENT CHARACTERISTICS.

- 3.1 **Interface and physical dimensions.** Fuseholders supplied to this CID shall be as specified herein and shall meet the requirements of [UL 4248-1](#) and [UL 4248-6](#) for class H fuseholders (see [figure 1](#)).
- 3.2 **Ampere rating.** The ampere rating shall be 30 amperes maximum.
- 3.3 **Voltage rating.** The voltage rating shall be 600 V ac maximum.
- 3.4 **Interrupting rating.** This class H fuseholder shall be used with class H fuses that have an interrupting rating of 10,000 amperes maximum.
- 3.5 **Wire termination.** Wire termination shall be specified on [figure 2](#) and as follows:
 - a. Screw connector for use with spade tugs or ring terminals.
 - b. Screw with pressure plate connector for use with solid or standard wire without terminal (recommended where vibration will be a factor).
 - c. Box lug connector (the most durable). For use with all types of wire without terminal.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data that may improve this document should be sent to: DLA Land and Maritime, ATTN: VAT, P.O. Box 3990, Columbus, OH 43218-3990, or email <mailto:CircuitProtect@dla.mil>. Since contact information can change you may want to verify the currency of the address information using the ASSIST Online database at <https://assist.dla.mil>.

A-A-55428D

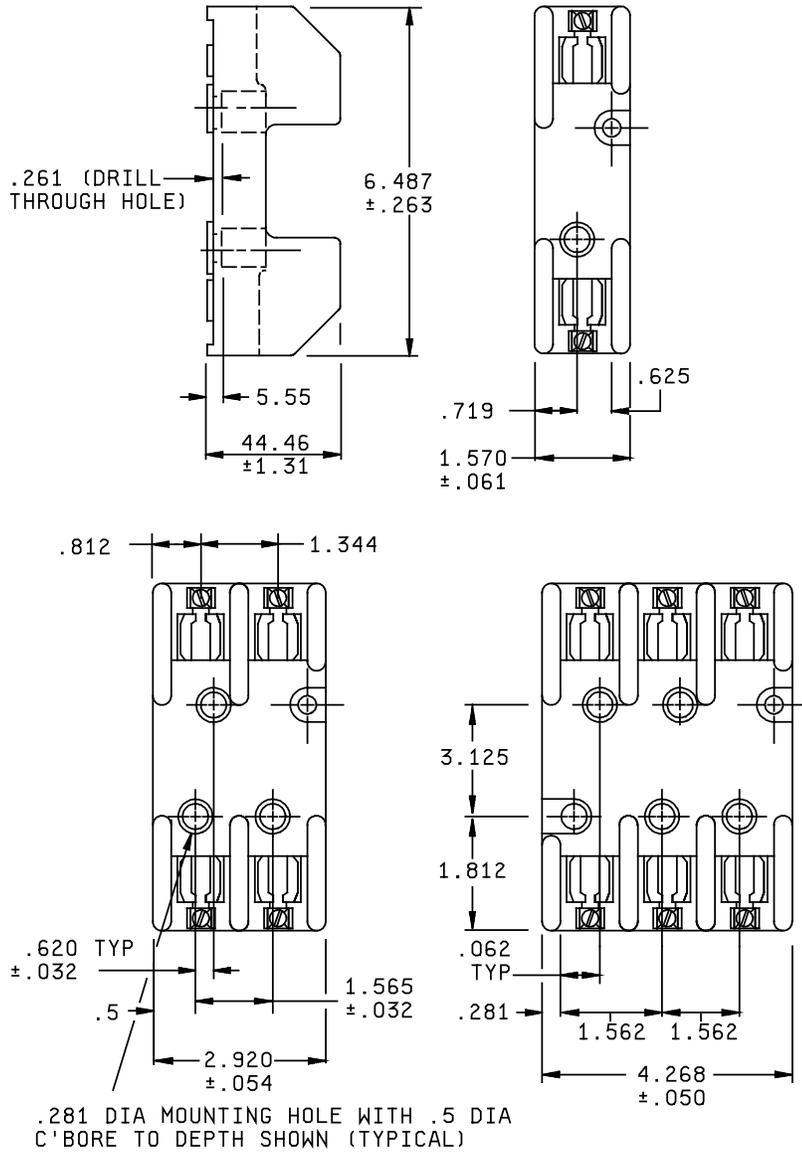


FIGURE 1. Configuration and dimensions.

Inches	mm	Inches	mm
.061	1.56	.796	20.24
.064	1.64	1.250	31.75
.065	1.65	1.310	33.33
.121	3.09	1.534	38.97
.218	5.55	1.750	44.45
.250	6.35	1.821	46.25
.261	6.63	2.625	66.67
.263	6.82	2.843	72.23
.406	10.31	4.750	102.65
.50	12.7	4.159	105.64
.546	13.89	4.487	113.96

NOTES:

1. Dimensions are in inches.
2. Tolerance is ± 0.005 inch (0.13 mm), unless otherwise specified.

FIGURE 1. Configuration and dimensions - Continued.

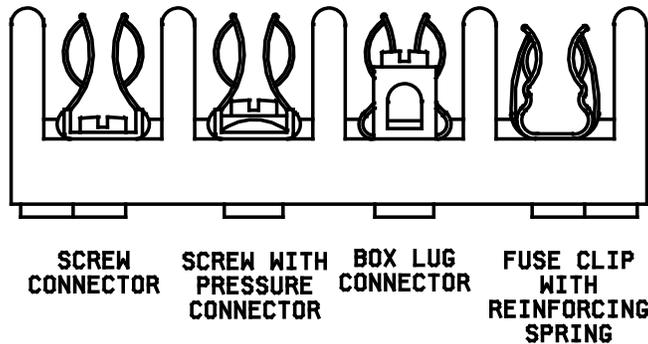


FIGURE 2. Wire termination configuration.

TABLE I. Characteristics.

AA55428-	Characteristics
001	1 pole with screw connectors.
002	1 pole with screw connectors. Fuse clips with reinforcing springs.
003	1 pole with screws with pressure plate connectors.
004	1 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs.
005	1 pole with box lug connectors.
006	1 pole with box lug connectors. Fuse clips with reinforcing springs.
007	2 pole with screw connectors.
008	2 pole with screw connectors. Fuse clips with reinforcing springs.
009	2 pole, screws with pressure plate connectors.
010	2 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs.
011	2 pole, screws with pressure plate connectors.
012	2 pole with box lug connectors. Fuse clip with reinforcing springs.
013	3 pole with screw connectors.
014	3 pole with screw connectors. Fuse clips with reinforcing springs.
015	3 pole, screws with pressure plate connectors.
016	3 pole, screw with pressure plate connectors. Fuse clips with reinforcing springs.
017	3 pole with box lug connectors.
018	3 pole with box lug connectors. Fuse clips with reinforcing springs.

3.6 Wire size. The maximum wire size shall be #10 CU for screw connectors and screw with pressure plate connectors and #4 CU for box lug connectors.

3.7 Reinforcing spring. Reinforcing springs are used for reinforcement of the fuse clip. Spring reinforced fuse clips are recommended if frequent fuse replacement is expected.

3.8 Fuse accomodation. This fuseholder accepts class H fuses with dimensions of 0.812 inch x 5.00 inches (20.63 mm x 127 mm).

3.9 Marking. Fuseholder supplied to this CID shall be marked with the manufacturer's (MFR's) standard commercial PIN and the UL listing mark. (NOTE: The part number marked on the unit pack shall be the CID PIN.)

3.10 Recycled, recovered, or environmentally preferable materials. Recycled, recovered, or environmentally preferable materials should be used to the maximum extent possible provided that the material meets or exceeds the operational and maintenance requirements, and promotes economically advantageous life cycle costs.

3.11 Workmanship. Fuseholders shall be processed in such a manner as to be uniform in quality and shall be free from other defects that will affect life, serviceability, or appearance.

4. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with 23.403 of the [Federal Acquisition Regulation \(FAR\)](#).

5. PRODUCT CONFORMANCE PROVISIONS

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

- a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.
- b. The company producing the item must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Environmentally preferable materials. Environmentally preferable materials should be used to the maximum extent possible to meet the requirements of this specification. As of the dating of this document, the U.S. Environmental Protection Agency (EPA) is focusing efforts on reducing 31 priority chemicals. The list of chemicals and additional information is available on their website <http://www.epa.gov/wastes/hazard/wastemin/priority.htm>. Included in the EPA list of 31 priority chemicals are cadmium, lead, and mercury. Use of these materials should be minimized or eliminated unless needed to meet the requirements specified herein (see section 3).

7.3 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuseholders to DLA Land and Maritime under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.4 Source of documents.

Federal Regulations

FEDERAL ACQUISITION REGULATION (FAR)

[FAR](#) - [Federal Acquisition Regulations.](#)

(Copies of this document are available online at <http://www.acquisition.gov/comp/far/index.html> or from the U.S. Government Printing Office, 732 N. Capital Street, NW, Washington D.C. 20401-0001.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

[UL 4248-1](#) - UL Standard for Safety Fuseholders – Part 1: General Requirements.

[UL 4248-6](#) - UL Standard for Safety Fuseholders – Part 6: Class H.

(Copies of these documents are available online at <http://www.ul.com/> or from the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.5 Ordering data. The contract or order should specify the following:

- a. CID document number, revision, and CID PIN.
- b. Product conformance provisions.
- c. Packaging requirements.

7.6 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

<u>MFR's CAGE</u>	<u>MFR's name and address</u>
26405	Marathon Special Products 13300 Van Camp Road P.O. Box 468 Bowling Green, OH 43402-0468 Phone number (419) 352-8441 Facsimile number (419) 352-0875 E-mail: mailto:marketing@marathonsp.com Uniform Resource Locator (URL): http://www.marathonsp.com/
71400	Cooper Bussmann, Incorporated P. O. Box 14460 St. Louis, MO 63178-4460 Phone number (636) 394-2877 Facsimile number (800) 544-2570 E-mail: mailto:fusebox@cooperindustries.com URL: http://www.cooperindustries.com
71424	Mersen 374 Merrimac Street Newburyport, MA 01950-1930 Phone number (978) 462-6662 Facsimile number (978) 462-0181 E-mail: mailto:technicalservices.nby@mersen.com URL: http://ep-us.mersen.com
75915	Littelfuse Incorporated 8755 W. Higgins Road; Suite 500 Chicago, IL 60631-2708 Phone number (800) 999-9445 Facsimile number (847) 391-0753 E-mail: mailto:electronics@littelfuse.com URL: http://www.littelfuse.com

7.7 Part number (P/N) supersession data. This CID PINs supersedes the following MFR's P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE III. P/N supersession data.

CID dash number AA55428-	MFR's CAGE 26405	MFR's CAGE 71400	MFR's CAGE 71424	MFR's CAGE 75915
	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>	MFR's P/N <u>1/</u>
001	6F30A1S	H60030-1S	60311	LH60030-1S
002	R6F30A1S	H60030-1SR	60316	LH60030-1SR
003	6F30A1SP	H60030-1P	60321	LH60030-1P
004	R6F30A1SP	H60030-1PR	60326	LH60030-1PR
005	6F30A1B	H60030-1C	60301	LH60030-1C
006	R6F30A1B	H60030-1CR	60306	LH60030-1CR
007	6F30A2S	H60030-2S	60312	LH60030-2S
008	R6F30A2S	H60030-2SR	60317	LH60030-2SR
009	6F30A2SP	H60030-2P	60322	LH60030-2P
010	R6F30A2SP	H60030-2PR	60327	LH60030-2PR
011	6F30A2B	H60030-2C	60302	LH60030-2C
012	R6F30A2B	H60030-2CR	60307	LH60030-2CR
013	6F30A3S	H60030-3S	60313	LH60030-3S
014	R6F30A3S	H60030-3SR	60318	LH60030-3SR
015	6F30A3SP	H60030-3P	60323	LH60030-3P
016	R6F30A3SP	H60030-3PR	60328	LH60030-3PR
017	6F30A3B	H60030-3C	60303	LH60030-3C
018	R6F30A3B	H60030-3CR	60308	LH60030-3CR

1/ The manufacturer's P/N shall not be used for acquisition to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown. For actual part marking requirements see [3.9](#).

7.8 Government users. To acquire information on obtaining these fuseholder blocks from the Government inventory system, contact DLA Land and Maritime, ATTN: DLA Land and Maritime-FMX, Post Office Box 3990, Columbus, OH 43218-3990, or telephone (614) 692-3677.

7.8.1 National stock number (NSN). The following is a list of NSN's assigned which correspond to this CID. The list is for information only and may not be indicative of all possible NSN's associated with the CID. For up to date information on assigned NSN's, please contact the aforementioned DLA Land and Maritime office (See [7.8](#)).

TABLE IV. NSN's.

Dash number (see table I) AA55428-	NSN	Dash number (see table I) AA55428-	NSN
001	5920-01-228-6830	010	5920-01-433-4054
002	N/A	011	5920-01-195-7252
003	N/A	012	N/A
004	N/A	013	N/A
005	N/A	014	5920-01-336-9844
006	N/A	015	5920-01-293-6530
007	5920-01-368-2979	016	5920-01-433-3773
008	5920-01-308-8582	017	N/A
009	N/A	018	N/A

7.9 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

MILITARY INTERESTS:

Custodians:
Navy - EC
DLA - CC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FAS

Preparing activity:

DLA-CC

Project 5920-2012-036

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at <https://assist.dla.mil>.