

INCH-POUND

MIL-PRF-15160/62H

31 May 2012

SUPERSEDING

MIL-PRF-15160/62G


9 August 2011

PERFORMANCE SPECIFICATION SHEET

FUSES, INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F62

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and [MIL-PRF-15160](#).

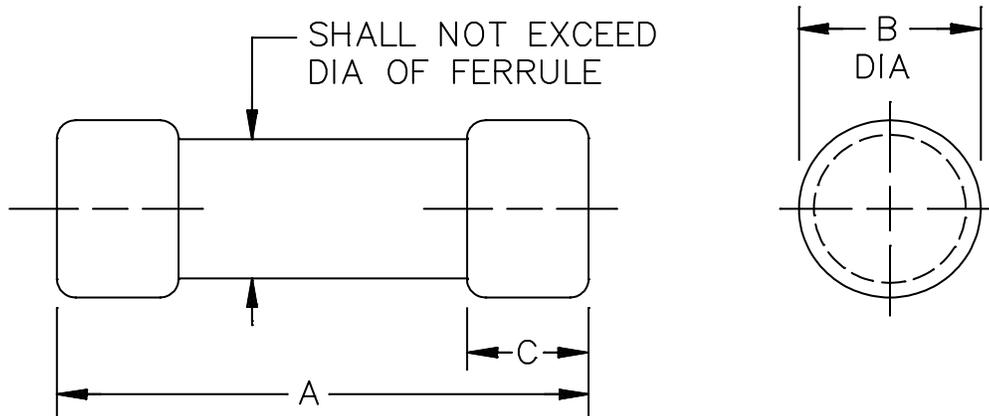

NOTES:

1. Dimensions are in inches.
2. Metric equivalents are given for general information only.

Ltr	Inches		mm	
	Min	Max	Min	Max
A	2.969	3.031	75.41	76.99
B	.804	.827	20.42	21.01
C	.605	.635	15.37	16.13

FIGURE 1. Style F62, characteristic C.

MIL-PRF-15160/62H

REQUIREMENTS:

Interface and physical dimensions: See [figure 1](#).

Case: Glass melamine.

Ferrule: Brass, copper, bronze, or copper alloy.

Finish: Nickel or bright alloy plate, silver plated when specified.

Terminal strength: [Method 211 of MIL-STD-202](#), test condition E, 2 pound-inch torque between ferrules and fuse body.

Electrical:

Current rating: See [table I](#).

Current carrying capacity: 110 percent of rated current.

Voltage rating: See [table I](#).

Characteristic: Characteristic C only.

Overload interrupt: Within 1 hour at 135 percent of rated current; and within 4 minutes at 200 percent.

Short circuit interrupt: 200,000 A at 500 V ac (symmetrical), 150,000 A at 500 V dc.

Shock: [Method 207 of MIL-STD-202](#), HI shock.

Vibration: [Method 204 of MIL-STD-202](#), test condition A (except 5g, 500 Hz).

Part or Identifying Number (PIN): The PIN shall be constructed from table I (e.g., F62C500V35A).

TABLE I. Type designation. ^{1/}

Style	Characteristic	Voltage	Current
F62	C	500V	35A
F62	C	500V	40A
F62	C	500V	45A
F62	C	500V	50A
F62	C	500V	60A

^{1/} For silver plated terminals, the designator "S" is added after the current rating.

MIL-PRF-15160/62H

VERIFICATION:

Qualification inspections: The number of qualification samples required shall be:

- a. 24 samples maximum current rating of each voltage and design.
- b. 24 samples minimum current rating of each voltage and design.

NOTE: If labels are used, five additional samples of any rating are required.

Sample size: The number of group III samples shall be twelve samples each of the maximum and minimum current ratings. The samples shall be divided as shown in [table II](#).

TABLE II. Short circuit test.

Number of samples	Short circuit current	Test voltage
3	5,000 A	500 V ac ^{1/}
3	200,000 A	500 V ac ^{1/}
3	5,000 A	500 V dc
3	150,000 A	500 V dc

^{1/} A 600 volt ac test voltage may be used.

Group C inspection: Group C inspection shall be performed on short circuit current ratings of 5,000 A at 500 V ac; 200,000 A at 500 V ac; and 5,000 A at 500 V dc. The 150,000 A at 500 V dc short circuit current test is not required to be performed for group C testing.

INSPECTION ROUTINE:

AC short circuit test: AC short circuit tests shall be performed at the currents shown in [table II](#) at not less than 500 volts, single phase, and not greater than 20 percent power factor, lagging. The current shall be applied within plus or minus 10 degrees of the zero point of the voltage wave.

DC short circuit test: DC short circuit tests shall be performed at the currents shown in [table II](#) at not less than 500 volts. The rate of rise shall be between 25,000,000 and 30,000,000 amperes per second.

Cross-reference: For applicable cross-reference see [table III](#). The existing stocks of superseded items may be used. When exhausted, the superseding parts shall be used.

TABLE III. Cross-reference.

Superseding number	Superseded numbers for CAGE	
	81349	96906
F62C500V35A	F62H35R0C	MS15251-1
F62C500V40A	F62H40R0C	MS15251-2
F62C500V45A	F62H45R0C	MS15251-3
F62C500V50A	F62H50R0C	MS15251-4
F62C500V60A	F62H60R0C	MS15251-5

MIL-PRF-15160/62H

Referenced documents. In addition to [MIL-PRF-15160](#), this document references the following:

[MIL-STD-202](#)

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:

Army - CR
Navy - SH
Air Force - 85
DLA - CC

Preparing activity:

DLA - CC

(Project 5920-2012-032)

Review activities:

Army - AR, AT, CR4, MI
Navy - AS, CG, MC, OS, YD
Air Force - 19, 99

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at <https://assist.daps.dla.mil/>.